

See discussions, stats, and author profiles for this publication at: <https://www.researchgate.net/publication/259120630>

A new approach to determine the outdoor temperature distributions for building energy calculations

Article in *Energy Conversion and Management* · February 2014

DOI: 10.1016/j.enconman.2013.10.052

CITATIONS

12

READS

327

4 authors, including:



Can Coskun

Izmir Democracy University

32 PUBLICATIONS 218 CITATIONS

[SEE PROFILE](#)



Mustafa Erturk

Sakarya University of Applied Sciences

59 PUBLICATIONS 143 CITATIONS

[SEE PROFILE](#)



Arif Hepbasli

Yasar University

131 PUBLICATIONS 4,053 CITATIONS

[SEE PROFILE](#)


Some of the authors of this publication are also working on these related projects:



Konutların Isıtma Sezonunda Seçilen İç Ortam Sıcaklık Parametresinin Enerji-Maliyet-Çevre Açısından Değerlendirilmesi ve Bir Uygulama Örneği [View project](#)



Winter Season Analysis of Global Warming Impact on Sivas Province [View project](#)



A new approach to determine the outdoor temperature distributions for building energy calculations



Can Coskun^{a,*}, Mustafa Ertürk^b, Zuhul Oktay^a, Arif Hepbasli^c

^a Department of Energy Systems Engineering, Faculty of Engineering, Recep Tayyip Erdogan University, Rize, Turkey

^b Department of Mechanical Engineering, Faculty of Engineering, Balıkesir University, Balıkesir, Turkey

^c Department of Energy Systems Engineering, Faculty of Engineering, Yasar University, 35100 Bornova, Izmir, Turkey

ARTICLE INFO

Article history:

Received 26 September 2013

Accepted 20 October 2013

Available online 19 November 2013

Keywords:

Energy
Outdoor temperature distribution
Degree-hours
Heating
Cooling

ABSTRACT

This study formulated annual, monthly and hourly ambient temperature distributions for simplifying the calculation of cooling and heating degree-hours. In this regard, Turkey was selected as an application country, of which 79 cities were considered for modeling purposes. The temperature data over a period of 42 years were also utilized in the analysis. Similar outdoor distributions were categorized in the same group. The analysis results showed eight main annual distribution trends for the cities in Turkey. Such a detailed analysis and categorization for the outdoor temperature has been done for the first time in the literature. The outdoor temperature distributions are very useful tools for determination of heating and cooling loads while they enable the calculation of the annual-, monthly- and hourly-based degree-hours values. In this regard, a population-based outdoor temperature distribution concept was also introduced to the literature and tested for Turkey. One temperature distribution was achieved for Turkey with reference to population.

© 2013 Elsevier Ltd. All rights reserved.

1. Introduction

Outdoor temperature conditions have a crucial impact on the energy consumption for heating and cooling. In order to predict the amount of energy consumption and to use energy efficiently, it is quite important to know the outdoor temperature distributions. Many heating/cooling firms spend a huge amount of money for determining the hourly outdoor distribution. It becomes easy to evaluate degree-hour values over any time period in a year by knowing the hourly outdoor temperature distribution. Firms mainly utilize the hourly outdoor distribution for economical evaluation of their heating/cooling machines and bidding strategies. Because of trade secrets, it is nearly impossible to achieve open access outdoor temperature distribution data for an academic research.

The degree-hour calculation method is one of the techniques using the outdoor temperature distribution to estimate and analyze the amount of energy for heating and cooling of residences. It is known that degree-hour values are calculated simply by summing up the differences between the hourly dry-bulb temperatures and a standard reference temperature (base temperature). The reference temperatures for heating/cooling in building applications vary from country to country. The determination of the degree-hour values correctly with smallest amount of error is substantially important for designers and manufacturers working in the heating

and cooling sector. Meanwhile, the use of the degree-hour values in the calculation of insulation thickness affects the direct costs and thus draws interest from investors. Many researchers [1–4] have determined the optimum insulation thickness for different applications using the degree-day or degree-hour method.

Several studies on analyzing the outdoor temperatures have been undertaken using degree-hour/day values to predict the energy and exergy requirements for the heating and cooling of buildings [5–10]. Coskun et al. [11–13] proposed the outdoor temperature distribution concept. They applied this approach to many cities in Turkey. They investigated monthly outdoor temperatures for five cities in Turkey. In this study, we have extended the mentioned studies (Ref. [11–13]) to 79 cities in Turkey. Also, the main difference of this investigation is to add hourly distribution concept to outdoor temperature calculation process. In this contribution, a new approach and demonstration method was proposed for heating and cooling degree-hours. We applied the proposed approach to determination of the annual, monthly and hourly temperature distribution trends in Turkey.

2. Analyzes

2.1. Determination of outdoor temperature distribution and degree-hour values

A temperature data set of 367,920 for each city was taken from the State Meteorology General Directorate in txt. file format. Those

* Corresponding author. Tel.: +90 464 223 7518; fax: +90 0464 223 7514.

E-mail address: dr.can.coskun@gmail.com (C. Coskun).

temperature data were transferred to a Microsoft office excel program for classification. A new programming was written in Matlab program for analyzing the classified temperature data. The Matlab program can read the data from the excel and calculate the annual, monthly and hourly distribution in percentage range at an interval of 1 °C. After determining the required temperature distribution in this range, it is transferred to hour based lapsed time (Fig. 1). Heating (*HDH*) or cooling (*CDH*) degree-hours values can be calculated using the hour based outdoor temperature distribution as follows:

$$HDH = \sum_{hours} (T_i - T_o)^+ \quad (1)$$

$$CDH = \sum_{hours} (T_o - T_i)^+$$

where T_i and T_o indicate the indoor and outdoor temperatures, respectively. The '+' sign over the parenthesis in the equations indicates that only positive values are to be included in the calculation.

In the calculation, the hourly dry-bulb outdoor temperature data, based on the last 42 years and recorded by the Turkish State Meteorological Station, were used. Annual ambient temperature distribution was determined for the 79 cities in Turkey and categorized into eight different distribution groups (Fig. 2). In this analysis, we investigated the 79 cities for modeling purposes in spite of there are 81 cities in Turkey. We did not cover 2 cities in the calculation. Main reason for this is that the long term full data sets for

two cities (Şırnak and Niğde) are not available in the Turkish State Meteorological Station. That is why we did not consider these cities (accounting for 1.019% of the total population of the country) for the calculation procedure. We assume that Turkey has 79 cities for modeling purposes'.

The annual ambient temperature distribution group for each city in Turkey is given in Table 1. X and Y-axes show the distribution and the outdoor temperature, respectively. In this analysis, the eight annual outdoor distribution trends were found in Turkey. Each country has different outdoor temperature characteristics. Different countries could be studied all over the world for determining their annual outdoor temperature distribution trends.

2.2. New demonstration concept

A new demonstration concept is introduced for standardization of degree-hour and outdoor temperature distribution. It contains five components, namely main body, month period (*MP*), time period (*TP*) and two temperature limits. The main body includes four components as follows: percentage (*P*), hour (*H*), cooling degree-hours (*CDH*) and heating degree-hours (*HDH*).

We can change four parameters, the month period (*MP*), the time period (*TP*), the highest (*HTL*) and the lowest temperature limit (*LTL*). Also we can find four values: the percentage, the time lapsed, the cooling and heating degree-hours for any month, time

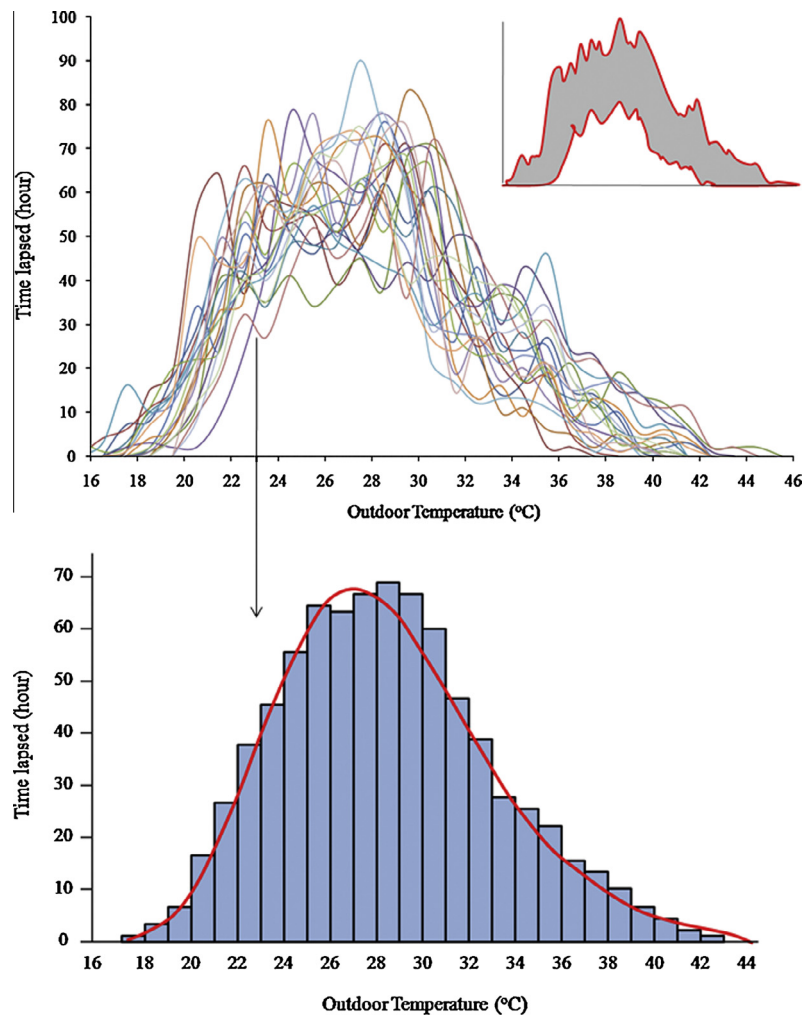


Fig. 1. Sample demonstration of outdoor temperature distribution determination for a month.

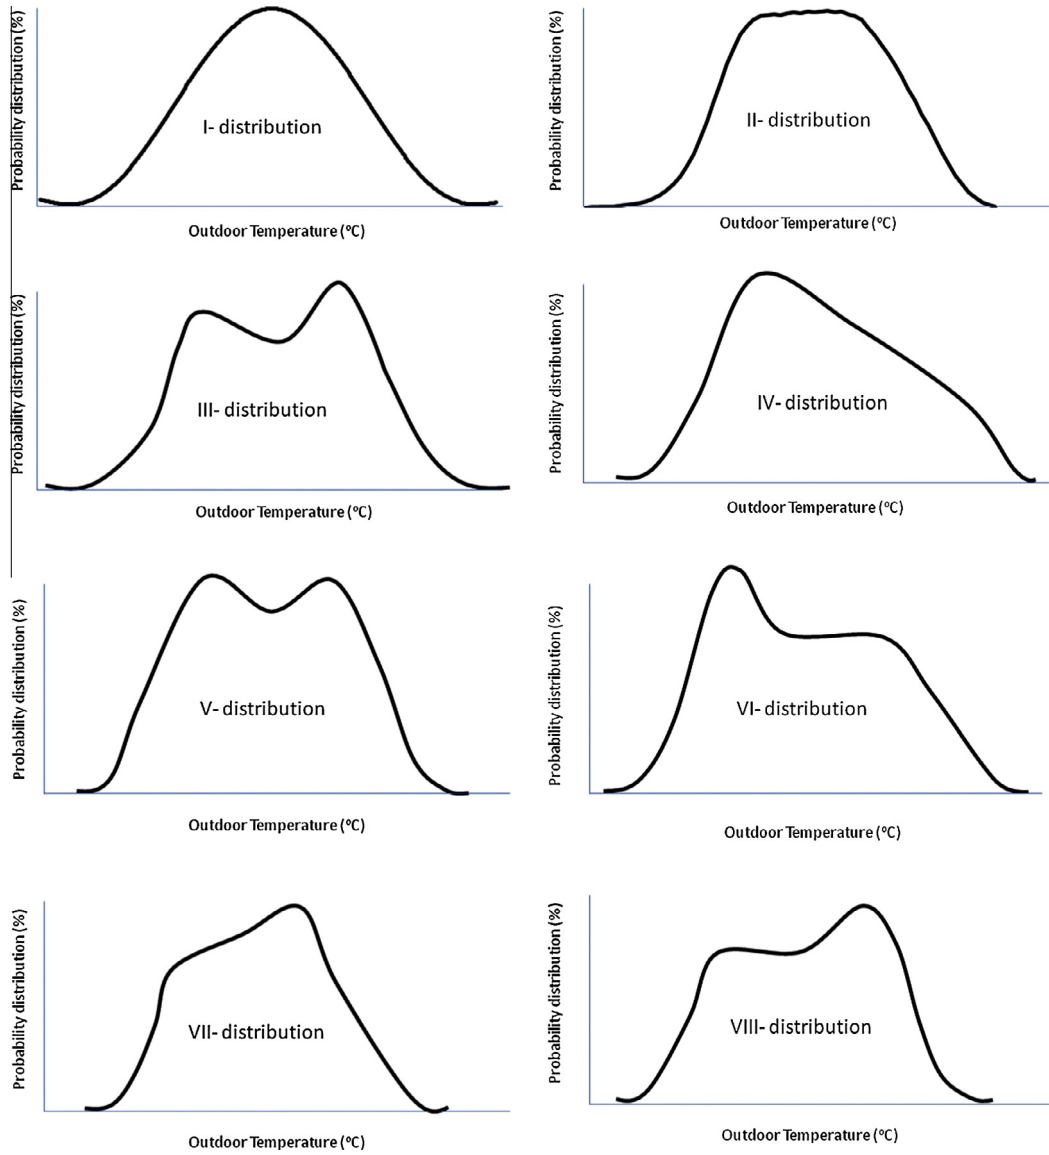


Fig. 2. Eight annual ambient temperature distribution trends.

Table 1
Annual ambient temperature distribution groups.

Distribution groups	Cities
I	Afyon, Aksaray, Burdur, Çanakkale, Düzce, Erzurum, Isparta, Karaman, Kütahya, Nevşehir
II	Balıkesir, Bursa, Bartın, Erzincan, İstanbul, Konya, Sakarya, Samsun, Kırklareli, Kırşehir, Yalova, Yozgat
III	Ankara, Antakya, Antalya, Ardahan, Artvin, Amasya, Bayburt, Kars
IV	Aydın, Batman, Denizli, Diyarbakır, Uşak
V	Ağrı, Çankırı, Çorum, Giresun, Hakkâri, Iğdır, İzmir, K.Maraş, Malatya, Tekirdağ, Kastamonu, Kilis, Mardin, Ordu, Rize, Sinop, Trabzon
VI	Adıyaman, Bingöl, Bitlis, Elazığ, Gaziantep, Manisa, Ş.Urfa, Muğla, Muş, Siirt, Tunceli, Van
VII	Bilecik, Eskişehir, Gümüşhane, Karabük, Kocaeli, Sivas, Tokat, Zonguldak
VIII	Adana, Bolu, Edirne, Kayseri, Mersin, Kırıkkale, Osmaniye

and ambient temperature limit. The new demonstration method is given by the following relations in this study:

$$\frac{MP}{TP} P_{LTL}^{HTL} \quad (2)$$

$$\frac{MP}{TP} H_{LTL}^{HTL} \quad (3)$$

$$\frac{MP}{TP} CDH_{LTL}^{HTL} \quad (4)$$

$$\frac{MP}{TP} HDH_{LTL}^{HTL} \quad (5)$$

The main part of the demonstration shows the percentage (P), the time lapsed (H), the cooling (CDH) and the heating degree-hours (HDH). A sample demonstration is given in Fig. 3 for the lapsed time between 15 and 22 °C ambient temperatures over a time period of 12:00 and 13:00 during the month of January. The abbreviations used are as follows: January (Jan), February (Feb),

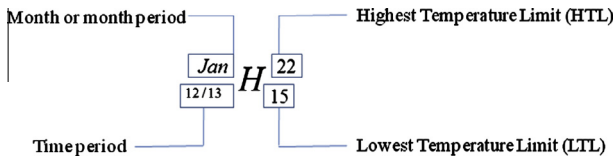


Fig. 3. Sample demonstration of the new concept.

March (Mar), April (Apr), May (May), June (Jun), July (Jul), August (Aug), September (Sept), October (Oct), November (Nov), December (Dec). Sample demonstrations and explanations are given in Table 2 for Eqs. (1)–(5).

2.3. Hourly and monthly temperature distribution

Space limitations prohibit showing the monthly distributions for all 79 cities in the analysis. A sample demonstration is given for the city of İzmir, which has the third highest population in Turkey. The lapsed time between any time intervals can be determined using the outdoor temperature distribution for a year. The annually-based time lapse for each outdoor temperature between 00:00 and 12:00 was determined and the data on the city of İzmir are given in Fig. 4. As can be seen from the figure, each time interval has a different distribution trend. Monthly-based lapsed time for each outdoor temperature can be calculated through the same method. A sample demonstration is given in Fig. 4 for the monthly-based lapsed time over a time interval of 12:00–13:00. Fig. 5 contains the January–June period for İzmir. The monthly and annual outdoor distribution is given in Fig. 6. As can be seen from the figure, the monthly outdoor temperature trends are very different than annual trends. Due to their wide variety, the monthly distribution trends were not classified.

To use the new demonstration concept and calculation method, the hourly, monthly and annually outdoor temperature distributions should be known. After determining the outdoor temperature distribution, the heating and cooling load can be easily calculated for any time interval in a year.

3. Determination of population-based outdoor temperature distribution

The annual outdoor temperature distribution for each city in Turkey was determined and thereby used to calculate the average annual outdoor temperature distribution for Turkey as a whole.

The population of each city was taken into account. The calculation procedure of the population-based outdoor temperature distribution is given by the following equations:

$${}_{0/24}^A P_{country}^{LTLC+1} = \sum_1^n \left[\left({}_{0/24}^A P_{city}(n)^{LTLC+1} \right) \cdot \left(\frac{PPL_{city}(n)}{PPL_{country}} \right) \right]$$

$${}_{0/24}^A P_{country}^{HTLC-1} = \sum_1^n \left[\left({}_{0/24}^A P_{city}(n)^{HTLC-1} \right) \cdot \left(\frac{PPL_{city}(n)}{PPL_{country}} \right) \right] \tag{6}$$

where *LTLC* and *HTLC* represent the lowest and highest temperature limits for the investigated country; *PPL_{city}* and *PPL_{country}* are the populations of the city and country considered in the study, respectively. The lowest and highest temperature limits of the country can be found from the outdoor temperature distribution of each city. In order to illustrate how to use Eq. (6), the average annual outdoor temperature distribution is calculated for a sample country with three cities. The populations of each city (*PPL_{city}*) are 1,400,000, 1,200,000 and 600,000 while the population of the country (*PPL_{country}*) is 3,200,000. The annual outdoor temperature distributions of the three cities are given in Table 3. As can be seen from the table, the *LTLC* and *HTLC* values are −9 and 47 °C.

Sample calculation is conducted for a −6/−7 outdoor temperature range as follows:

$${}_{0/24}^A P_{country}^{-6} = \sum_1^3 \left[\left({}_{0/24}^A P_{city}(1)^{-6} \right) \cdot \left(\frac{PPL_{city}(1)}{PPL_{country}} \right) + \left({}_{0/24}^A P_{city}(2)^{-6} \right) \cdot \left(\frac{PPL_{city}(2)}{PPL_{country}} \right) + \left({}_{0/24}^A P_{city}(3)^{-6} \right) \cdot \left(\frac{PPL_{city}(3)}{PPL_{country}} \right) \right]$$

$${}_{0/24}^A P_{country}^{-6} = \sum_1^3 \left[(0.017895133) \cdot \left(\frac{1,400,000}{3,200,000} \right) + (0.002236426) \cdot \left(\frac{1,200,000}{3,200,000} \right) + (0.007202399) \cdot \left(\frac{600,000}{3,200,000} \right) \right]$$

$${}_{0/24}^A P_{country}^{-6} = \sum_1^3 \left[(0.017895133) \cdot (0.4375) + (0.002236426) \cdot (0.3750) + (0.007202399) \cdot (0.1875) \right]$$

Table 2
Sample demonstrations and explanations of the new demonstration concept.

Demonstration	Explanation	Time period	Month period	Highest temperature limit	Lowest temperature limit
$\frac{Jun/Aug}{10/16} P_{22}^{HTL}$	Percentage (%)	Between 10:00 and 16:00	Between June and August	HTL	22 °C
$\frac{A}{10/17} P_{LTL}^{22}$	Percentage (%)	Between 10:00 and 17:00	Annual	22 °C	LTL
$\frac{A}{0/24} P_{20}^{30}$	Percentage (%)	During the day	Annual	30 °C	20 °C
$\frac{Jan/Apr}{07/17} H_{LTL}^{18}$	Time lapsed (h)	Between 07:00 and 17:00	Between January and April	18 °C	LTL
$\frac{Apr}{10/20} H_{LTL}^{25}$	Time lapsed (h)	Between 10:00 and 20:00	April	25 °C	LTL
$\frac{Apr}{10/18} H_{24}^{HTL}$	Time lapsed (h)	Between 10:00 and 18:00	April	HTL	25 °C
$\frac{Jun/Aug}{10/16} CDH_{22}^{HTL}$	Cooling degree-hours	Between 10:00 and 16:00	Between June and August	HTL	22 °C Base temperature
$\frac{A}{10/16} CDH_{22}^{HTL}$	Cooling degree-hours	Between 10:00 and 16:00	Annual	HTL	22 °C Base temperature
$\frac{A}{0/24} CDH_{22}^{HTL}$	Cooling degree-hours	During the day	Annual	HTL	22 °C Base temperature
$\frac{A}{0/24} HDH_{LTL}^{19}$	Heating degree-hours	During the day	Annual	19 °C Base temperature	LTL
$\frac{Jan}{6/18} HDH_{LTL}^{19}$	Heating degree-hours	Between 06:00 and 18:00	January	19 °C Base temperature	LTL
$\frac{Jan/Apr}{6/18} HDH_{LTL}^{19}$	Heating degree-hours	Between 06:00 and 18:00	Between January and April	19 °C Base temperature	LTL

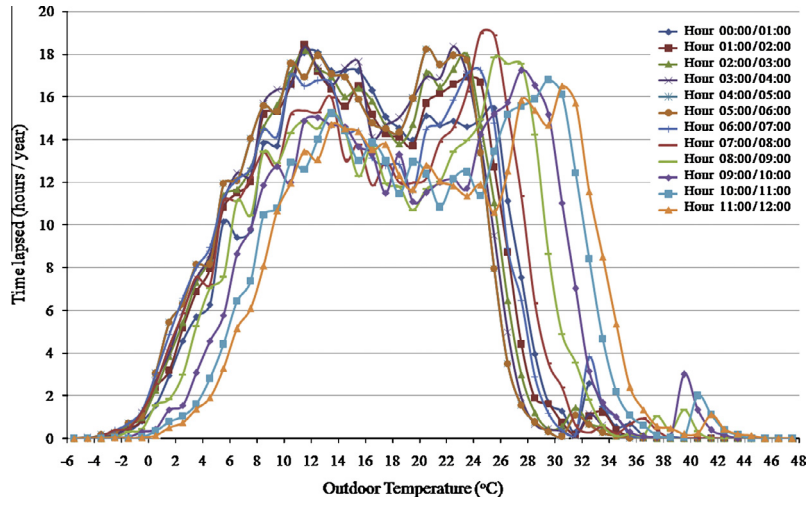


Fig. 4. Distribution of annually-based time lapsed between 00:00 and 12:00 for İzmir.

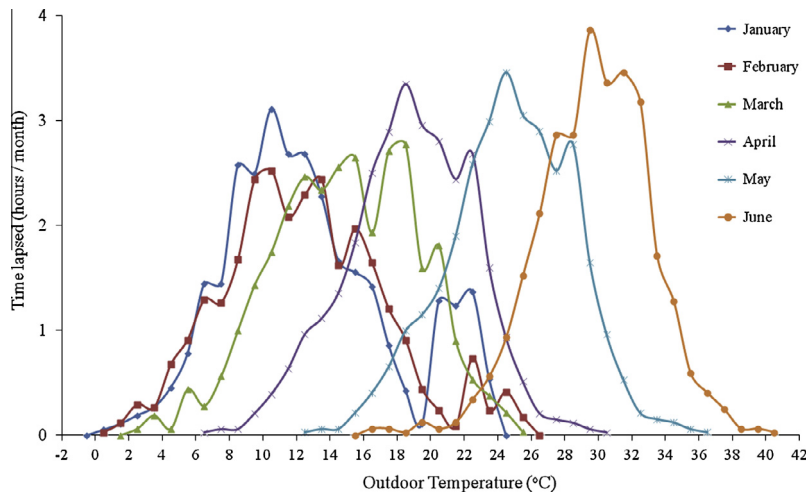


Fig. 5. Monthly based lapsed time for 12:00–13:00 time interval in İzmir.

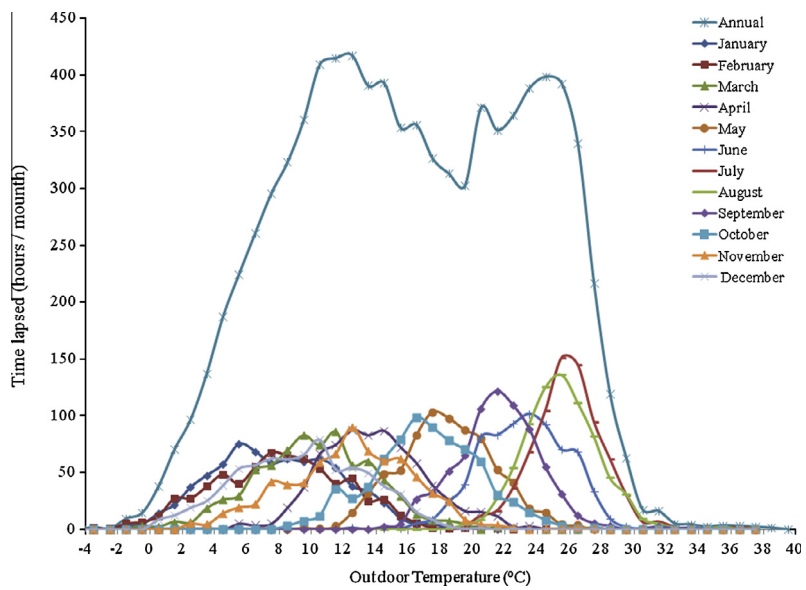


Fig. 6. Monthly and annual lapsed time distribution for İzmir.

Table 3
Annual outdoor temperature distributions of three cities.

Temp. range	Annual outdoor temperature distribution (%)			Population rate (-)			${}_{0/24}^A P_{country}{}_{-9}^{47}$			
	City-1	City-2	City-3							
-9/-8	0.003840954	-	-	0.4375	0.375	0.1875	0.001680	-	-	0.001680
-8/-7	0.008664888	-	0.004998770	0.4375	0.375	0.1875	0.003791	-	0.000937	0.004728
-7/-6	0.017895133	0.002236426	0.007202399	0.4375	0.375	0.1875	0.007829	0.000839	0.001350	0.010018
-6/-5	0.042585971	0.009543531	0.020887771	0.4375	0.375	0.1875	0.018631	0.003579	0.003916	0.026127
-5/-4	0.067838894	0.026871189	0.051112574	0.4375	0.375	0.1875	0.029680	0.010077	0.009584	0.049340
-4/-3	0.136957448	0.051131148	0.105808710	0.4375	0.375	0.1875	0.059919	0.019174	0.019839	0.098932
-3/-2	0.222788666	0.125788139	0.167021232	0.4375	0.375	0.1875	0.097470	0.047171	0.031316	0.175957
-2/-1	0.506043540	0.234299317	0.295015586	0.4375	0.375	0.1875	0.221394	0.087862	0.055315	0.364572
-1/0	0.863757122	0.381553328	0.460270271	0.4375	0.375	0.1875	0.377894	0.143082	0.086301	0.607277
0/1	1.578280515	0.780291620	0.811078770	0.4375	0.375	0.1875	0.690498	0.292609	0.152077	1.135184
1/2	2.011935357	1.213366903	1.234515249	0.4375	0.375	0.1875	0.880222	0.455013	0.231472	1.566706
2/3	2.326599826	1.762383855	1.518499471	0.4375	0.375	0.1875	1.017887	0.660894	0.284719	1.963500
3/4	2.820349774	2.440913534	2.020237357	0.4375	0.375	0.1875	1.233903	0.915343	0.378795	2.528040
4/5	3.240402551	2.947926248	2.500511079	0.4375	0.375	0.1875	1.417676	1.105472	0.468846	2.991994
5/6	3.555959539	3.682422238	3.210411862	0.4375	0.375	0.1875	1.555732	1.380908	0.601952	3.538593
6/7	3.725959910	4.175801942	3.551329107	0.4375	0.375	0.1875	1.630107	1.565926	0.665874	3.861907
7/8	4.045649259	4.544494992	3.761175483	0.4375	0.375	0.1875	1.769972	1.704186	0.705220	4.179378
8/9	3.962736105	4.630967975	3.885982656	0.4375	0.375	0.1875	1.733697	1.736613	0.728622	4.198932
9/10	3.640948414	4.264235256	3.490673519	0.4375	0.375	0.1875	1.592915	1.599088	0.654501	3.846504
10/11	3.867960905	4.411175486	3.602421291	0.4375	0.375	0.1875	1.692233	1.654191	0.675454	4.021878
11/12	3.816318941	4.222448880	3.166499206	0.4375	0.375	0.1875	1.669640	1.583418	0.593719	3.846776
12/13	4.017049666	4.172771512	3.052221156	0.4375	0.375	0.1875	1.757459	1.564789	0.572291	3.894540
13/14	3.937945918	4.224887576	2.882704919	0.4375	0.375	0.1875	1.722851	1.584333	0.540507	3.847691
14/15	4.036157103	4.261504875	2.749802887	0.4375	0.375	0.1875	1.765819	1.598064	0.515588	3.879471
15/16	4.148264231	4.317474489	2.635700313	0.4375	0.375	0.1875	1.814866	1.619053	0.494194	3.928112
16/17	4.266482157	4.159250425	2.590153444	0.4375	0.375	0.1875	1.866586	1.559719	0.485654	3.911959
17/18	4.218597672	4.263961330	2.450609281	0.4375	0.375	0.1875	1.845636	1.598985	0.459489	3.904111
18/19	4.314600542	4.599393166	2.516892205	0.4375	0.375	0.1875	1.887638	1.724772	0.471917	4.084327
19/20	3.965767154	4.397463591	2.390585672	0.4375	0.375	0.1875	1.735023	1.649049	0.448235	3.832307
20/21	4.164672555	4.563893564	2.783158549	0.4375	0.375	0.1875	1.822044	1.711460	0.521842	4.055347
21/22	3.717182125	4.219362591	2.691537879	0.4375	0.375	0.1875	1.626267	1.582261	0.504663	3.713192
22/23	3.353646990	3.943199975	2.782908920	0.4375	0.375	0.1875	1.467221	1.478700	0.521795	3.467716
23/24	2.917685106	3.633635827	2.713058636	0.4375	0.375	0.1875	1.276487	1.362613	0.508698	3.147799
24/25	2.576704880	3.063328428	2.841353513	0.4375	0.375	0.1875	1.127308	1.148748	0.532754	2.808810
25/26	2.232721965	2.659497774	2.946535245	0.4375	0.375	0.1875	0.976816	0.997312	0.552475	2.526603
26/27	1.894472913	1.716789875	2.865551729	0.4375	0.375	0.1875	0.828832	0.643796	0.537291	2.099919
27/28	1.630357676	1.052015662	2.817050291	0.4375	0.375	0.1875	0.713281	0.394506	0.528197	1.635984
28/29	1.335965502	0.479577360	2.819733796	0.4375	0.375	0.1875	0.584485	0.179842	0.528700	1.293027
29/30	0.951022532	0.236603476	2.583737026	0.4375	0.375	0.1875	0.416072	0.088726	0.484451	0.989249
30/31	0.719821069	0.082231930	2.523568175	0.4375	0.375	0.1875	0.314922	0.030837	0.473169	0.818928
31/32	0.441868280	0.021503043	2.263641540	0.4375	0.375	0.1875	0.193317	0.008064	0.424433	0.625814
32/33	0.294415509	0.011725750	2.077371285	0.4375	0.375	0.1875	0.128807	0.004397	0.389507	0.522711
33/34	0.169970878	0.004970318	1.880705365	0.4375	0.375	0.1875	0.074362	0.001864	0.352632	0.428858
34/35	0.100573103	0.002135137	1.684471139	0.4375	0.375	0.1875	0.044001	0.000801	0.315838	0.360640
35/36	0.057812033	0.000723380	1.577364285	0.4375	0.375	0.1875	0.025293	0.000271	0.295756	0.321320
36/37	0.030370277	0.002135137	1.418979148	0.4375	0.375	0.1875	0.013287	0.000801	0.266059	0.280146
37/38	0.015972689	0.001400090	1.210004107	0.4375	0.375	0.1875	0.006988	0.000525	0.226876	0.234389
38/39	0.011994101	-	0.905146263	0.4375	0.375	0.1875	0.005247	-	0.169715	0.174962
39/40	0.006323738	-	0.639817615	0.4375	0.375	0.1875	0.002767	-	0.119966	0.122732
40/41	0.003150202	-	0.436687948	0.4375	0.375	0.1875	0.001378	-	0.081879	0.083257
41/42	0.001750112	-	0.234048312	0.4375	0.375	0.1875	0.000766	-	0.043884	0.044650
42/43	0.001400090	-	0.120874403	0.4375	0.375	0.1875	0.000613	-	0.022664	0.023276
43/44	0.000350022	-	0.034313863	0.4375	0.375	0.1875	0.000153	-	0.006434	0.006587
44/45	-	-	0.010500672	0.4375	0.375	0.1875	-	-	0.001969	0.001969
45/46	-	-	0.001050067	0.4375	0.375	0.1875	-	-	0.000197	0.000197
46/47	-	-	0.000700045	0.4375	0.375	0.1875	-	-	0.000131	0.000131

$${}_{0/24}^A P_{country}{}_{-7}^{-6} = \sum_{i=1}^3 [(0.007829) + (0.000839) + (0.001350)]$$

$$= 0.10018\%$$

In this study, the average outdoor temperature distribution for Turkey was calculated and given in Fig. 7 using the new calculation concept. As can be seen from this figure, the highest lapsed time for Turkey occurs between an outdoor temperature range of 10 and 11 °C. The average annual outdoor temperature distribution for Turkey is similar to distribution-I given in Fig. 1.

4. Building heating and cooling loads

Building heating and cooling loads mainly depend on outdoor temperature, solar radiation, moisture content, wind speed and direction. Outdoor, solar, moisture and wind speed distribution should be known for accurate building heating or cooling load calculations. Our resource team investigates the mentioned four distribution trends for each city in Turkey. This study is one part of the data set preparation for the national building energy analyzes program. The data set for outdoor temperature distributions for Turkey was completed. Solar, moisture and wind speed distribution were completed with a rate of 35% while it is also planned

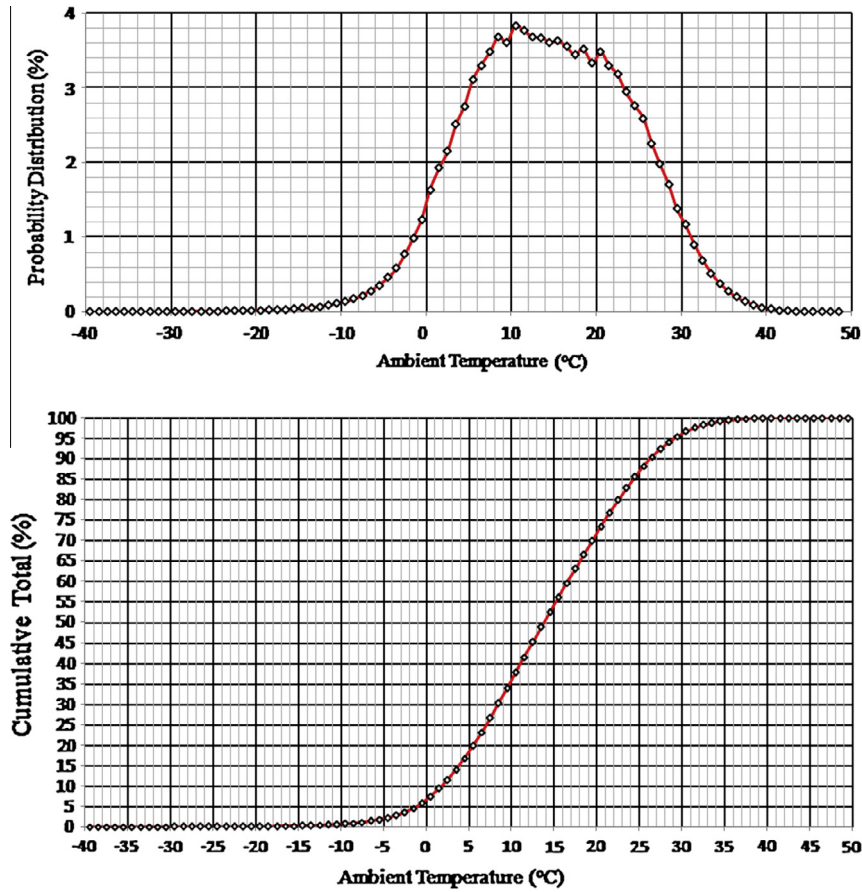


Fig. 7. Population-based outdoor temperature distribution in Turkey.

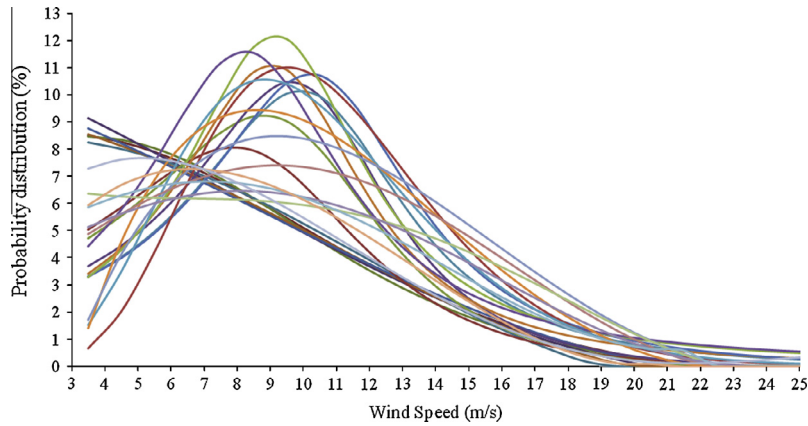


Fig. 8. Hourly wind speed distribution for a sample month.

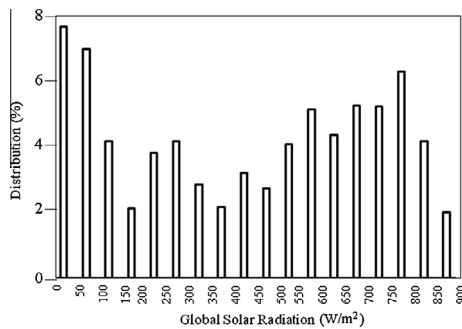


Fig. 9. Hourly global solar radiation distribution for a sample month.

to complete all data set within the 3 years. After determination of four distributions, the national building energy analyzes program will be designed. A sample demonstration of hourly solar radiation and wind speed distribution is given in Figs. 8 and 9.

5. Conclusions

We have formulated the probable hourly, monthly and annual outdoor temperature distributions to simplify the calculation of cooling and heating degree-hour in this study. We have also developed a new approach and demonstration method, which simplifies the gathering of information for any user, who wants to undertake

detailed energy calculations. This method can be directly used by designers, engineers and energy managers for practical applications.

Some concluding remarks of the study may be listed as follows:

- (a) Outdoor temperature distributions did not have a similar distribution pattern for each city. However, since the distribution had a stable trend, the similar trends were grouped together. Cities having similar distributions were categorized into eight different groups and were given in figures.
- (b) An hourly and monthly outdoor temperature distribution concept was proposed.
- (c) A population-based country outdoor temperature distribution concept was proposed.
- (d) A new demonstration concept was introduced for standardization of the degree-hour and outdoor temperature distribution.
- (e) This is the first practical method available in the literature for determination of the probable cooling degree-hours values for both each month and part-time operating buildings.

Acknowledgment

The authors would like to thank the reviewers due to their valuable and constructive comments, which have been very useful in improving the quality of the paper.

References

- [1] Ozel M. Determination of optimum insulation thickness based on cooling transmission load for building walls in a hot climate. *Energy Convers Manage* 2013;66:106–14.
- [2] Keçebaş A. Determination of insulation thickness by means of exergy analysis in pipe insulation. *Energy Convers Manage* 2012;58:76–83.
- [3] Söylemez MS, Ünsal M. Optimum insulation thickness for refrigeration applications. *Energy Convers Manage* 1999;40(1):13–21.
- [4] Sodha MS, Bharadwaj SK, Kumar Ashvini. Optimization of insulation thickness of various pipes in air heating applications. *Energy Convers Manage* 1989; 29(2):151–6.
- [5] Badescu V, Zamfir E. Degree-days, degree-hours and ambient temperature bin data from monthly-average temperatures (Romania). *Energy Convers Manage* 1999;40(8):885–900.
- [6] Christenson M, Manz H, Gyalistras D. Climate warming impact on degree-days and building energy demand in Switzerland. *Energy Convers Manage* 2006;47(6):671–86.
- [7] Durmayaz A, Kadioğlu M. Heating energy requirements and fuel consumptions in the biggest city centers of Turkey. *Energy Convers Manage* 2003;44(7): 1177–92.
- [8] Saïd SAM, Habib MA, Iqbal MO. Database for building energy prediction in Saudi Arabia. *Energy Convers Manage* 2003;44(1):191–201.
- [9] Fischer RD, Flanigan LJ, Talbert SG, Jaffe D. Degree-days method for simplified energy analysis. *ASHRAE Trans* 1982;88:522–71.
- [10] Zhang Q. Climatic zoning for the thermal design of residences in China based on heating degree-days and cooling degree-hours. *J Asian Archit Build Eng* 2005;4:533–9.
- [11] Coskun C. A novel approach to degree-hour calculation: Indoor and outdoor reference temperature based degree-hour calculation. *Energy* 2010;35: 2455–60.
- [12] Coskun C, Demiral D, Ertürk M, Oktay Z. Modified degree-hour calculation method. *Solar Power* 2012;57–62.
- [13] Oktay Z, Coskun C, Dincer I. A new approach for predicting cooling degree hours and energy requirements in buildings. *Energy* 2011;36(8):4855–63.